

UPSHUR - RURAL ELECTRIC COOPERATIVE CORP.

P.O. BOX 70 GILMER, TEXAS 75644

OVERHEAD SERVICE ENTRANCE ON METER POLE

If mobile home or other structure is not on site, stake four (4) corners of structure.

Put stake with pink ribbon 5' to 10' from structure for METER POLE location.

Face meter loop away from the structure.


BE SURE THE FOLLOWING ITEMS ARE ON THE METER POLE BEFORE CALLING.

- Correct wire size
- Weather head
- Correct size conduit
- Correct meter base
- Main disconnect
- Ground wire (clamped to ground rod)

When meter pole is set and loop is mounted on pole, call the Consumer Service Department at 843-2536 or Toll Free 1-800-259-2536 for hook-up and set.

Meter MUST be accessible for meter reader to read each month.

Dogs and other animals should not be placed in an area that may hinder access to the meter by Cooperative personnel.

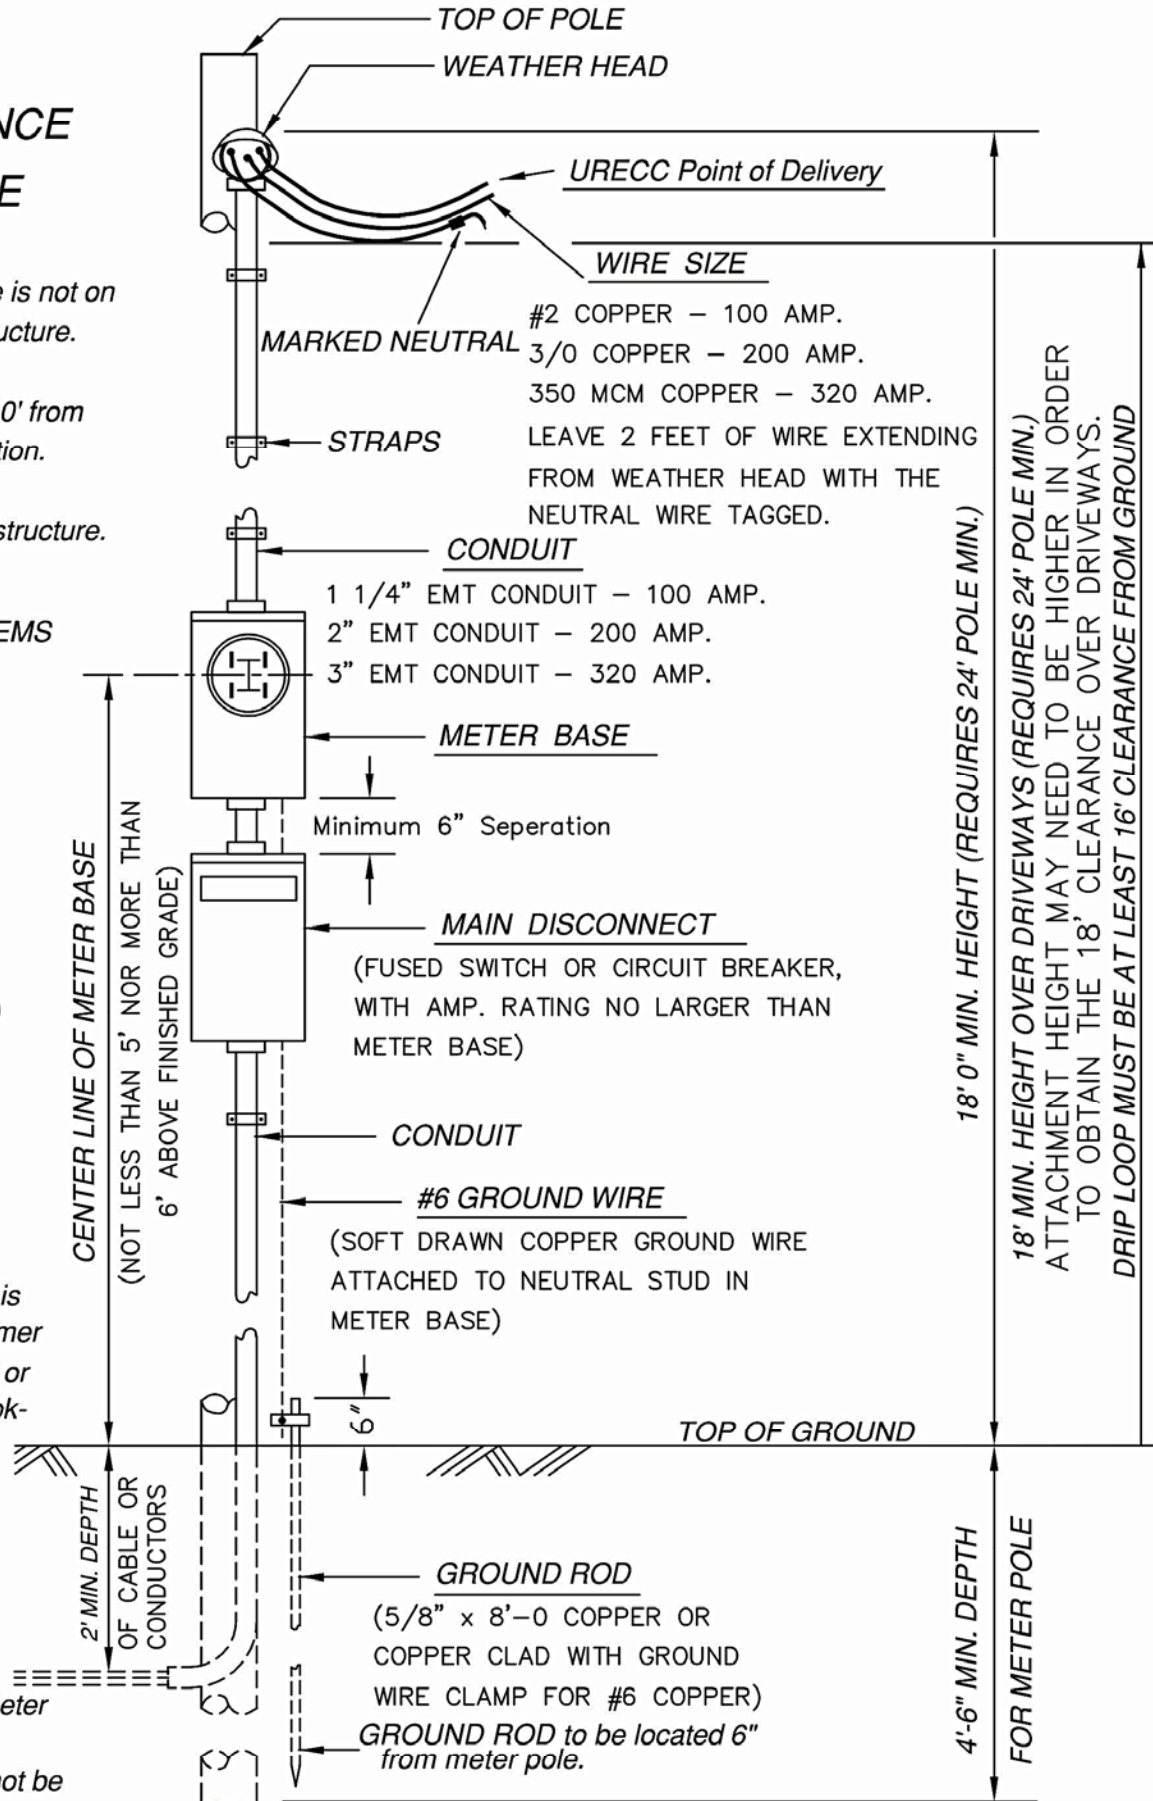

18' 0" MIN. HEIGHT (REQUIRES 24' POLE MIN.)
 18' MIN. HEIGHT OVER DRIVEWAYS (REQUIRES 24' POLE MIN.)
 ATTACHMENT HEIGHT MAY NEED TO BE HIGHER IN ORDER TO OBTAIN THE 18' CLEARANCE OVER DRIVEWAYS.
 DRIP LOOP MUST BE AT LEAST 16' CLEARANCE FROM GROUND

4'-6" MIN. DEPTH
 FOR METER POLE